


JOB SKETCH WO# 18088617
SHEET 2 OF 2
DIRECTIONAL DRILL CANDIDATE



HP SYSTEM

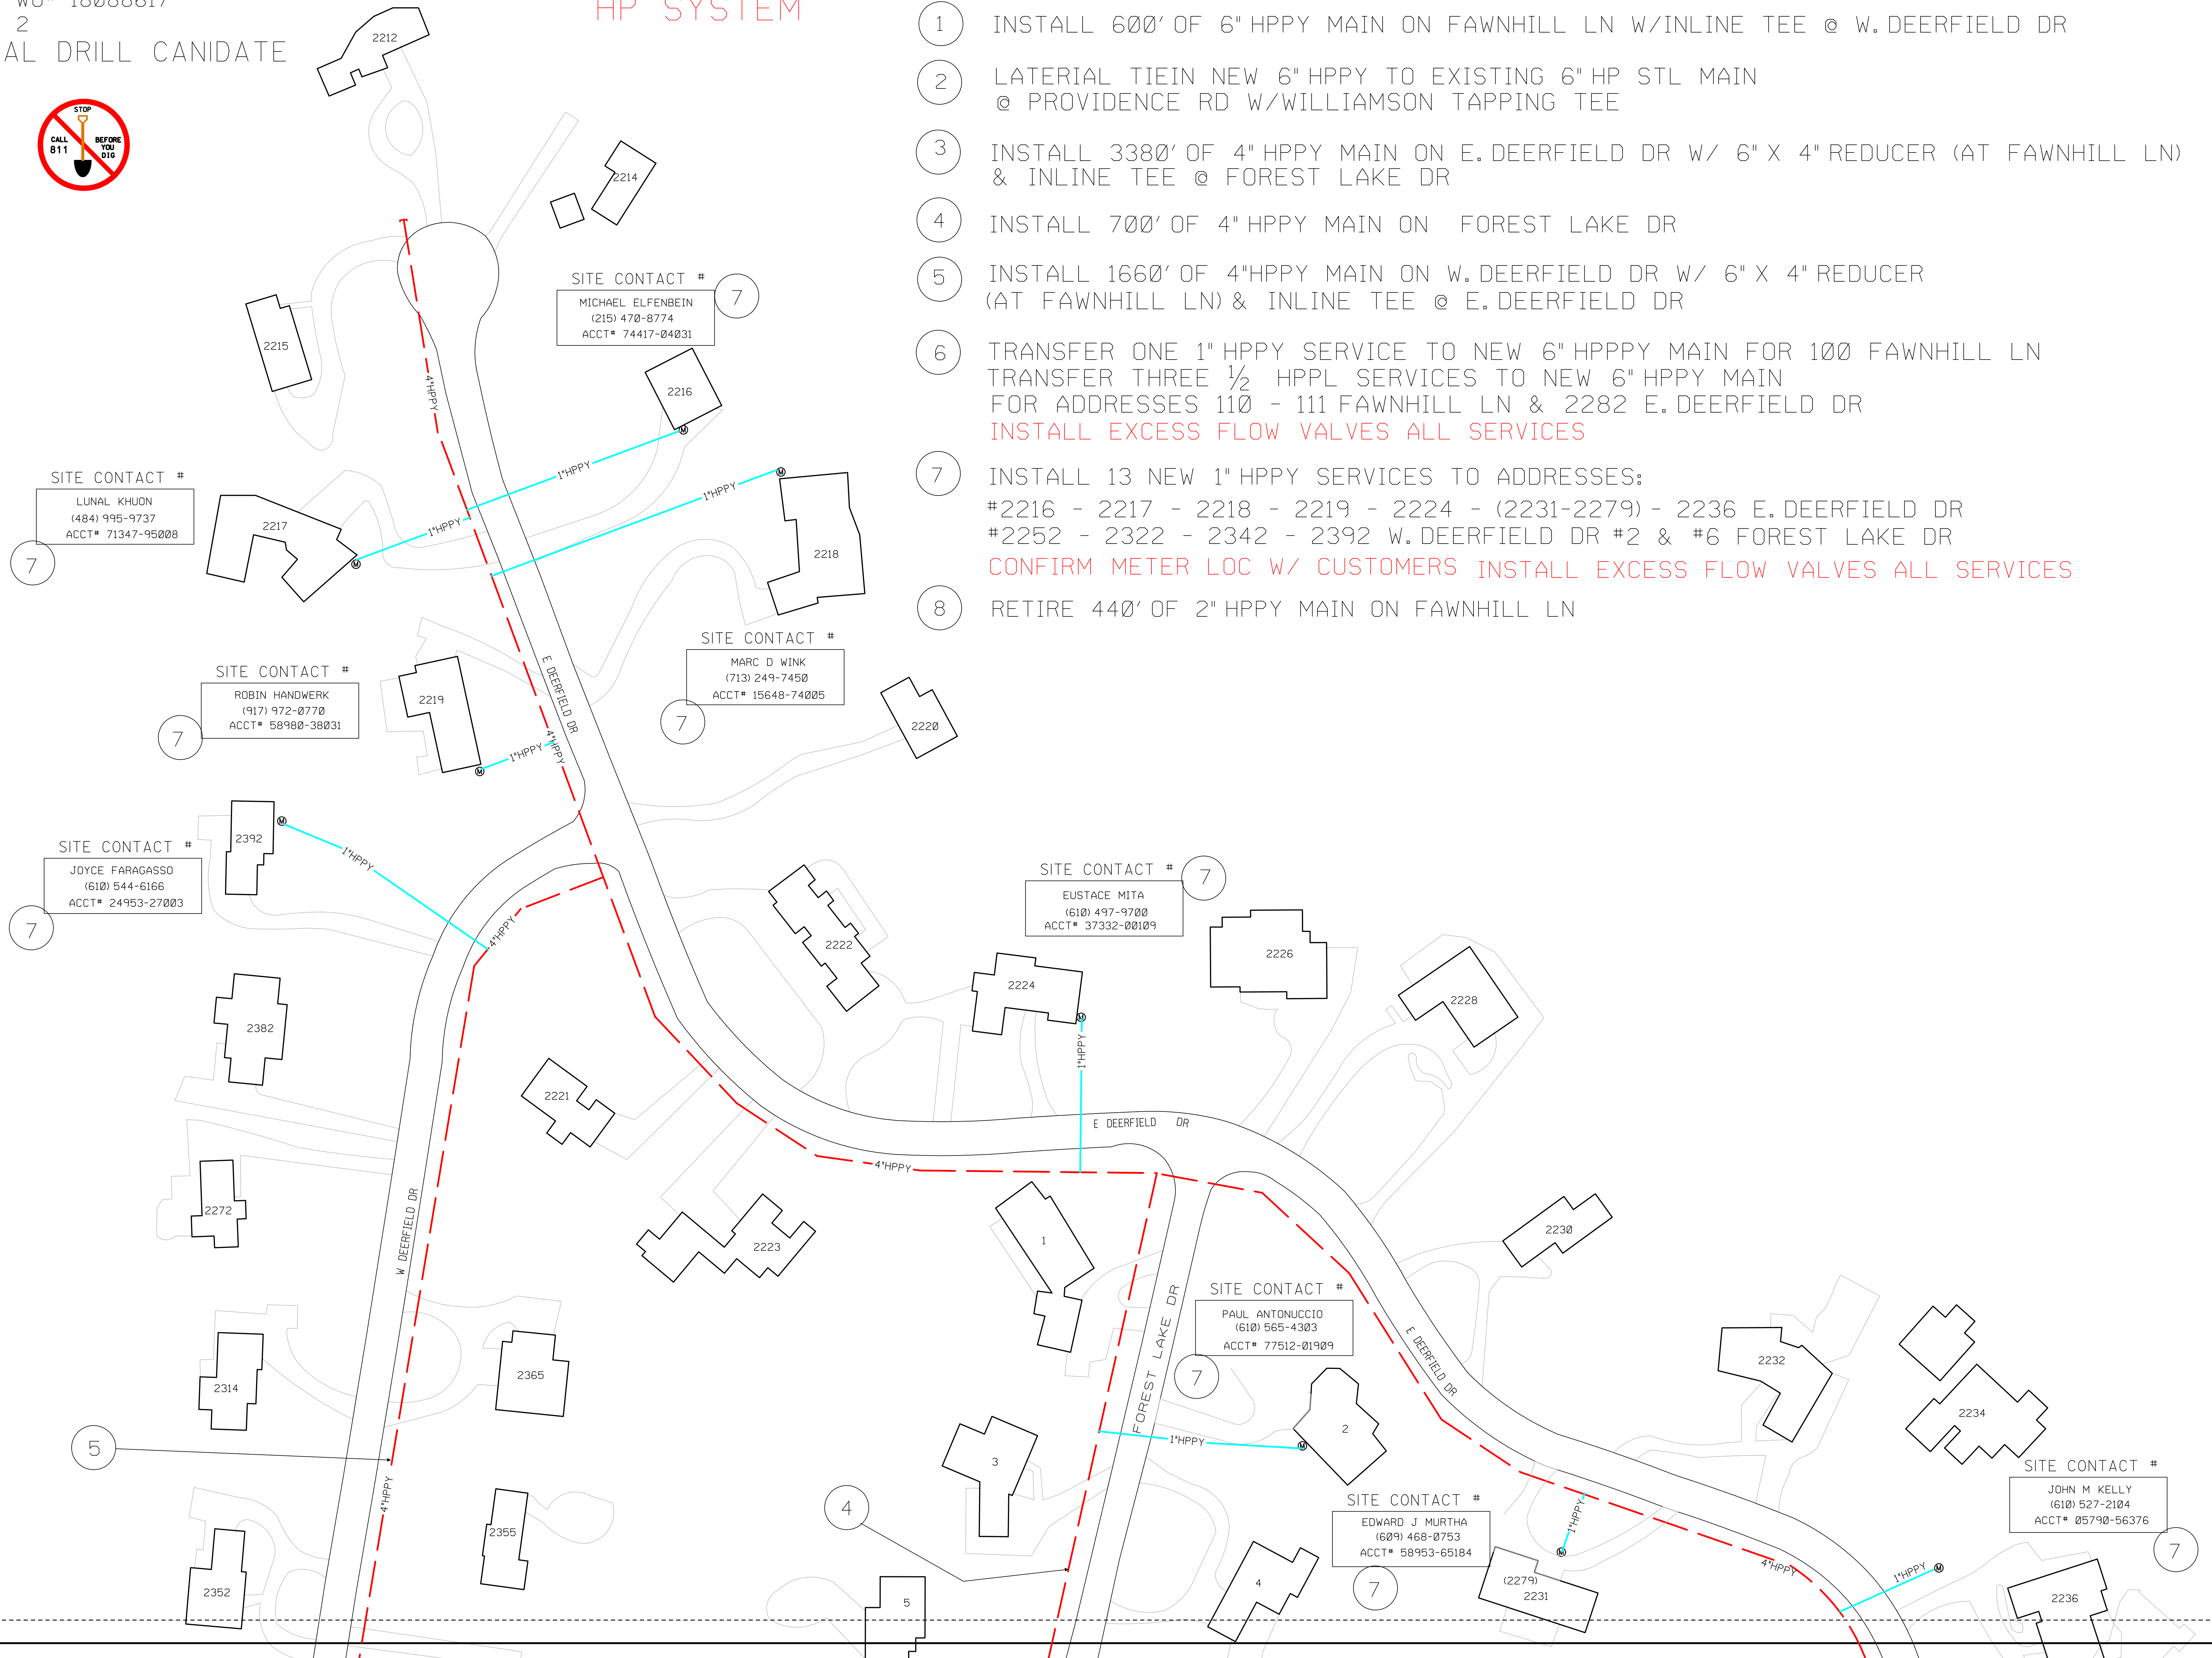

- 1 INSTALL 600' OF 6" HPPY MAIN ON FAWN HILL LN W/ INLINE TEE @ W. DEERFIELD DR
- 2 LATERAL TIE IN NEW 6" HPPY TO EXISTING 6" HP STL MAIN @ PROVIDENCE RD W/ WILLIAMSON TAPPING TEE
- 3 INSTALL 3380' OF 4" HPPY MAIN ON E. DEERFIELD DR W/ 6" X 4" REDUCER (AT FAWN HILL LN) & INLINE TEE @ FOREST LAKE DR
- 4 INSTALL 700' OF 4" HPPY MAIN ON FOREST LAKE DR
- 5 INSTALL 1660' OF 4" HPPY MAIN ON W. DEERFIELD DR W/ 6" X 4" REDUCER (AT FAWN HILL LN) & INLINE TEE @ E. DEERFIELD DR
- 6 TRANSFER ONE 1" HPPY SERVICE TO NEW 6" HPPY MAIN FOR 100 FAWN HILL LN
TRANSFER THREE 1/2" HPPL SERVICES TO NEW 6" HPPY MAIN FOR ADDRESSES 110 - 111 FAWN HILL LN & 2282 E. DEERFIELD DR
INSTALL EXCESS FLOW VALVES ALL SERVICES
- 7 INSTALL 13 NEW 1" HPPY SERVICES TO ADDRESSES:
#2216 - 2217 - 2218 - 2219 - 2224 - (2231-2279) - 2236 E. DEERFIELD DR
#2252 - 2322 - 2342 - 2392 W. DEERFIELD DR #2 & #6 FOREST LAKE DR
CONFIRM METER LOC W/ CUSTOMERS INSTALL EXCESS FLOW VALVES ALL SERVICES
- 8 RETIRE 440' OF 2" HPPY MAIN ON FAWN HILL LN

