

UPTSA 2024 Pump Station Invoices

Upper Prov./Operations & Maintenance

Service Date:	Location	Cust#	Jobsite#	Hours	Line item	Price per hour	Tech notes:	Total per WO	WO#
7/5/2025	Upper Providence Township Sewer Authority	2673442	1930867	1	IS-C-WWTP-Lift & Pump Station Operations	\$7,240.33	Monthly O&M	\$7,240.33	6588182941
							Pump Station Total	\$7,240.33	
Upper Prov./Bortondale									

Service Date:	Location	Cust#	Jobsite#	Hours	Line item	Price per hour	Tech notes:	Total per WO	WO#
7/8/2025	Upper Providence/Bortondale	2673442	1930598	4	Project-C-Hours-Foreman-Mechanic-OT	\$157.82	Responded to pump #1 fault. Reset and cleared faults. Found blown fuse. Replaced fuse. Muffin Monster was not operating.	\$631.28	6588196237
7/9/2025	Upper Providence/Bortondale	2673442	1930598	4	Project-C-Hours-Foreman-Mechanic-OT	\$157.82	Responded to high level and back up floats alarm. Alarms caused by heavy rain event. Pumps operating ok, level slowly went down. Observed proper operation before departure.	\$631.28	6588196700
7/16/2025	Upper Providence/Bortondale	2673442	1930598	3	Project-C-Hours-Foreman-Mechanic	\$105.21	Pulled Air Release Valve #1 and cleared blockage. Replaced and installed new shear pin.	\$315.63	6588197531
7/16/2025	Upper Providence/Bortondale	2673442	1930598	3	Project-C-Hours-Mechanic	\$97.54	Pulled Air Release Valve #1 and cleared blockage. Replaced and installed new shear pin.	\$292.62	6588197532
7/16/2025	Upper Providence/Bortondale	2673442	1930598	3	Project-C-Hours-Mechanic	\$97.54	Pulled Air Release Valve #1 and cleared blockage.	\$292.62	6588197533
7/27/2025	Upper Providence/Bortondale	2673442	1930598	4	Project-C-Hours-Foreman-Mechanic	\$157.82	Responded to a power failure alarm. Power was restored	\$631.28	6588198938
							Pump Station Total	\$2,794.71	

Upper Prov/Rosetree Estates Lower

Service Date:	Location	Cust#	Jobsite#	Hours	Line item	Price per hour	Tech notes:	Total per WO	WO#
7/21/2025	Upper Providence/Rose Tree Estates (Lower)	2673442	1930603	3	Project-C-Hours-Foreman-Mechanic	105.21	Picked up pump from Municipal Maintenance.	\$315.63	6588198070
							Pump Station Total	\$315.63	

Upper Prov/Valley View


Service Date:	Location	Cust#	Jobsite#	Hours	Line item	Price per hour	Tech notes:	Total per WO	WO#
7/3/2025	Upper Providence/Valley View	2673442	1930609	2	Project-C-Hours-Foreman-Mechanic	\$105.21	Inflated tires on generator to proper PSI	\$210.42	6588195580
7/24/2025	Upper Providence/Valley View	2673442	1930609	2	Project-C-Hours-Foreman-Mechanic	\$105.21	Troubleshoot and cleaned priming system #2.	\$210.42	6588198752
7/24/2025	Upper Providence/Valley View	2673442	1930609	2	Project-C-Hours-Mechanic	\$97.54	Troubleshoot and cleaned priming system #2.	\$195.08	6588198753
							Pump Station Total	\$615.92	

Upper Prov/Winters Street

Service Date:	Location	Cust#	Jobsite#	Hours	Line item	Price per hour	Tech notes:	Total per WO	WO#
7/1/2025	Upper Providence/Winter Street	2673442	1930611	1	Project-C-Materials	\$1,149.60	Responded to an emergency call (6/25/25) for the Winter Street generator.	\$1,149.60	6588196651
7/14/2025	Upper Providence/Winter Street	2673442	1930611	1	Project-C-Hours-Foreman-Mechanic	\$105.21	Unlocked gate for generator repair.	\$105.21	6588197265
7/14/2025	Upper Providence/Winter Street	2673442	1930611	1	Project-Materials	\$2,364.00	Completed repairs on the Godwin Generator	\$2,364.00	6588198940
7/15/2025	Upper Providence/Winter Street	2673442	1930611	3	Project-C-Hours-Mechanic	\$97.54	Responded to a power failure and high level alarms. Found generator running but not putting out proper voltage. Both thermals were tripped on pumps. Called in vacuum truck to maintain station. Called in contractor to evaluate issue. Found the generator was only putting out enough voltage for single phase. Observed proper operation before departure.	\$292.62	6588198914

7/15/2025	Upper Providence/Winter Street	2673442	1930611	4	Project-C-Hours-Foreman-Mechanic-OT	\$157.82	Responded to a power failure and high level alarms. Found generator running but not putting out proper voltage. Both thermals were tripped on pumps. Called in vacuum truck to maintain station. Called in contractor to evaluate issue. Found the generator was only putting out enough voltage for single phase. Observed proper operation before departure.	\$631.28	6588198915
7/15/2025	Upper Providence/Winter Street	2673442	1930611	4	Project-C-Hours-Pump Truck-OT	\$291.68	Call out to maintain level at pump station.	\$1,166.72	6560007249
							Pump Station Total	\$5,709.43	

**OK TO PAY
KEVIN MATSON, PE,
OPERATIONS MANAGER**

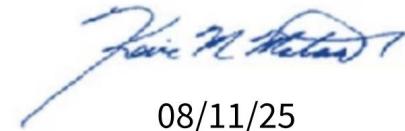

08/11/25